

Brian Tarbuck, General Manager
btarbuck@greateraugustautilitydistrict.org

Ken Knight, Board Chair
kknight@greateraugustautilitydistrict.org

Pat Paradis, Clerk
pparadis@greateraugustautilitydistrict.org

Bob Corey, Treasurer
bcorey@greateraugustautilitydistrict.org



www.greateraugustautilitydistrict.org
12 Williams Street
Augusta, ME 04330-5225
(207) 622-3701

Cecil Munson
cmunson@greateraugustautilitydistrict.org

Bradley Sawyer
bsawyer@greateraugustautilitydistrict.org

Keith Taylor, Hallowell voting member
ktaylor@greateraugustautilitydistrict.org

Keith Luke, Augusta ex-officio member
kluke@greateraugustautilitydistrict.org

Kara Tudman Walker, Hallowell ex-officio member
ktwalker@greateraugustautilitydistrict.org

February 10, 2025

Denise Douin
State of Maine, Drinking Water Program
11 State House Station
Augusta, ME 04333-0011

Dear Denise:

Please find attached the monthly reports for compliance with the Safe Drinking Water Act and Maine's Rules Relating to Drinking Water for January, 2025.

You should find the following documents:

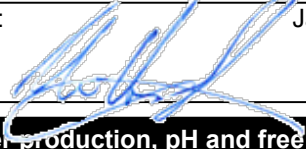
1. Operating report;
2. Water production report;
3. Triangle fluoridation report; and
4. Togus disinfection report.

Note that due to a PFAS 'sum of six' sample result of 23.3 parts per trillion that the Riverside station wells were removed from service on November 19, 2024.

If you have any questions, please contact me at 622-3701.

Sincerely,

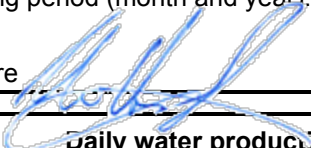
Brian Tarbuck, PE, System Class IV 2026

Monthly Operating Report		System Information	
System Type - All GW systems		Treatment plant/pump station: Triangle & Riverside	
System Name:	Greater Augusta Utility District	Community water system	
PWSID#:	90080	List any new or changed system information and any operational problems or comments below.	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period:	January, 2025		
Signature:		2/10/2025	

Water production, pH and free chlorine residual							Chemical usage					
Triangle Station				Riverside Station			Triangle Station			Riverside Station		
Date	Gallons (MGD)	pH	Average free chlorine residual	Gallons (MGD)	pH	Average free chlorine residual	Calc	Hypo	NaF	Calc	Hypo	NaF
							gal	gal	lbs	gal	gal	lbs
1	1.34	7.91	1.36	Riverside out of service			4.0	17.6		Riverside out of service		
2	1.67	7.94	1.29				4.7	22.6				
3	1.58	7.93	1.25				4.4	19.9				
4	1.51	7.93	1.20				4.0	18.8				
5	1.63	7.95	1.15				4.3	20.1				
6	1.61	7.94	1.20				4.4	20.3	100			
7	1.56	7.94	1.31				4.4	19.4				
8	1.68	7.94	1.32				4.5	20.8				
9	1.76	7.95	1.35				4.6	21.4				
10	1.70	7.93	1.35				4.3	20.4				
11	1.65	7.93	1.37				4.3	19.8				
12	1.51	7.93	1.40				4.0	18.6				
13	1.69	7.95	1.25				4.6	20.5	100			
14	1.67	7.97	1.21				4.8	20.7				
15	1.62	7.97	1.24				4.6	20.1	50			
16	1.62	7.97	1.24				4.5	20.3				
17	1.58	7.97	1.23				4.4	20.4				
18	1.62	7.96	1.23				4.6	20.0				
19	1.61	7.96	1.22				4.4	20.5				
20	1.40	7.94	1.27				3.8	17.6				
21	1.61	7.95	1.20				3.9	20.5	100			
22	1.61	7.95	1.21				4.1	20.8				
23	1.61	7.96	1.25				4.8	20.5				
24	1.61	7.97	1.26				5.0	20.9				
25	1.61	7.97	1.26				5.2	20.7				
26	1.60	7.97	1.25				5.1	20.5				
27	1.61	7.97	1.24				5.1	20.5	100			
28	1.56	7.97	1.27				5.3	19.9				
29	1.60	7.97	1.31				5.5	20.2				
30	1.56	7.97	1.30				5.5	19.8				
31	1.60	7.97	1.32				5.6	20.1				
Summary	49.59	7.95	1.15	0.00	#DIV/0!	0.00	143	624	450	0	0	0
	Sum	Average	(min.)	Sum	Average	(min.)	(total)	(total)	(total)	(total)	(total)	(total)

Chemicals Used					
(fluoride reported separately)					
	Chemical Name	Purpose	Chemical Strength	Total	Units
Calc	Calcquest 75 / 25	calcium sequestration / Pb / Cu control	75% polyphosphate	143	gallons
Hypo	Sodium hypochlorite	primary and secondary disinfection	12.50%	624	gallons
NaF	Sodium fluoride	fluoridation		450	pounds

Summary of Total Coliform Bacteria Rule - please continue to submit complete results			
Number of routine samples taken:	27	Number of repeat samples taken:	0
Number of positive samples:	0	Average chlorine residual at sites:	0.84

Monthly Well Production Report		System Information	
System Type - All GW systems		Treatment plant/pump station: All wells	
System Name:	Greater Augusta Utility District	Community System	
PWSID#:	90080	List any new or changed system information (facilities, treatments, sources, operators, address, tele, etc.):	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period (month and year):		January, 2025	
Signature 		February 10, 2025	

Daily water production (MG)				
Date	Triangle Well	South Well	Brookside Well	Sum Triangle Station
1	0.49	0.03	0.82	1.34
2	0.85	0.05	0.77	1.67
3	0.62	0.17	0.79	1.58
4	0.59	0.13	0.79	1.51
5	0.82	0.04	0.77	1.63
6	0.71	0.12	0.79	1.61
7	0.62	0.16	0.78	1.56
8	0.48	0.43	0.77	1.68
9	0.61	0.40	0.75	1.76
10	0.51	0.42	0.77	1.70
11	0.45	0.44	0.77	1.65
12	0.34	0.37	0.80	1.51
13	0.48	0.43	0.78	1.69
14	0.73	0.18	0.76	1.67
15	0.85	0.00	0.77	1.62
16	0.85	0.00	0.78	1.62
17	0.83	0.00	0.75	1.58
18	0.84	0.00	0.77	1.62
19	0.84	0.00	0.77	1.61
20	0.60	0.00	0.80	1.40
21	0.84	0.00	0.78	1.61
22	0.84	0.00	0.78	1.61
23	0.83	0.00	0.78	1.61
24	0.84	0.00	0.78	1.61
25	0.83	0.00	0.77	1.61
26	0.83	0.00	0.77	1.60
27	0.83	0.00	0.78	1.61
28	0.81	0.00	0.75	1.56
29	0.83	0.00	0.77	1.60
30	0.78	0.00	0.77	1.56
31	0.83	0.00	0.78	1.60
Sum	22.20	3.37	24.06	49.59

South well was removed from service after inspection on January 14 showed that the pump had cracked and needed to be replaced. The pump was replaced on February 5th. Upon successful mechanical testing, disinfection and receipt of a water sample that was negative for bacteria the well was returned to service on February 7th.

Average flow: 1.60

Monthly Fluoride Report		System Information			
System Type - Fluoride Systems		Treatment plant: Triangle Station			
System Name: Greater Augusta Utility District		Chemical Used: Sodium fluoride			
PWSID#: 90080					
Reporting period: January, 2025		Notes: See notes below for specific operating conditions.			
Signature:  2/10/2025		Date	GAUD mg/L	Location	A&L mg/L
		1/9/2025	0.67	12 Williams Street	0.63
Fluoride					Operating comments
Date	Gallons (MGD)	Makeup water (gallons)	Daily residual (mg/L)	Calculated residual (mg/L)	
1	1.34	41	0.64	0.54	
2	1.67	53	0.70	0.57	
3	1.58	50	0.73	0.57	
4	1.51	47	0.76	0.56	
5	1.63	52	0.78	0.58	
6	1.61	51	0.73	0.57	
7	1.56	49	0.79	0.56	
8	1.68	53	0.82	0.56	
9	1.76	55	0.82	0.56	
10	1.70	56	0.72	0.59	
11	1.65	56	0.71	0.61	
12	1.51	49	0.68	0.58	
13	1.69	57	0.80	0.61	
14	1.67	59	0.82	0.63	
15	1.62	58	0.78	0.65	
16	1.62	57	0.75	0.64	
17	1.58	55	0.72	0.62	
18	1.62	56	0.72	0.63	
19	1.61	57	0.71	0.64	
20	1.40	49	0.70	0.63	
21	1.61	56	0.70	0.63	
22	1.61	58	0.77	0.65	
23	1.61	59	0.81	0.65	
24	1.61	59	0.82	0.66	
25	1.61	58	0.80	0.64	
26	1.60	54	0.81	0.61	
27	1.61	51	0.76	0.57	
28	1.56	52	0.78	0.60	
29	1.60	53	0.77	0.60	
30	1.56	52	0.77	0.60	
31	1.60	53	0.76	0.60	
Avg	1.60	53.65	0.76	0.60	
Min	1.34	40.50	0.64	0.54	
Max	1.76	58.80	0.82	0.66	
Total	49.59	1,663.20			

Greater Augusta Utility District, PWSID 90080

Operator: Brian Tarbuck, 2026

Togus Disinfection Station, Route 17 Augusta, Maine

Reporting month: January, 2025

Reporting date: 2/3/2025

Date	Flow (gallons)	Average chlorine residual (mg/L)	Sodium hypochlorite usage (gallons)	Operating notes
1/1/2025	47,045	2.60	0.99	
1/2/2025	68,373	2.60	1.45	
1/3/2025	53,898	2.71	1.13	
1/4/2025	47,199	2.83	1.03	
1/5/2025	20,212	2.87	0.43	
1/6/2025	60,751	2.88	1.28	
1/7/2025	60,597	2.71	1.34	
1/8/2025	114,880	2.76	2.49	
1/9/2025	55,707	2.78	1.16	
1/10/2025	60,327	2.65	1.31	
1/11/2025	54,052	2.60	1.13	
1/12/2025	54,899	2.58	1.15	
1/13/2025	108,065	2.71	2.31	
1/14/2025	47,353	2.65	0.99	
1/15/2025	101,097	2.53	2.05	
1/16/2025	60,635	2.43	1.30	
1/17/2025	67,526	2.42	1.42	
1/18/2025	47,276	2.43	1.02	
1/19/2025	94,206	2.45	2.01	
1/20/2025	54,822	2.62	1.17	
1/21/2025	60,443	2.63	1.32	
1/22/2025	60,789	2.48	1.31	
1/23/2025	101,829	2.51	2.13	
1/24/2025	61,521	2.49	1.47	
1/25/2025	47,199	2.44	0.99	
1/26/2025	94,129	2.54	2.03	
1/27/2025	53,936	2.62	1.13	
1/28/2025	60,789	2.72	1.27	
1/29/2025	101,867	2.56	2.14	
1/30/2025	88,701	2.30	1.67	
1/31/2025	53,821	2.47	1.12	
Sum	2,063,946		43.74	
Average	66,579	2.60	1.41	
Max		2.88		

Brian Tarbuck, General Manager
btarbuck@greateraugustautilitydistrict.org

Ken Knight, Board Chair
kknight@greateraugustautilitydistrict.org

Pat Paradis, Clerk
pparadis@greateraugustautilitydistrict.org

Bob Corey, Treasurer
bcorey@greateraugustautilitydistrict.org



www.greateraugustautilitydistrict.org
12 Williams Street
Augusta, ME 04330-5225
(207) 622-3701

Cecil Munson
cmunson@greateraugustautilitydistrict.org

Bradley Sawyer
bsawyer@greateraugustautilitydistrict.org

Keith Taylor, Hallowell voting member
ktaylor@greateraugustautilitydistrict.org

Keith Luke, Augusta ex-officio member
kluke@greateraugustautilitydistrict.org

Kara Tudman Walker, Hallowell ex-officio member
ktwalker@greateraugustautilitydistrict.org

March 4, 2025

Denise Douin
State of Maine, Drinking Water Program
11 State House Station
Augusta, ME 04333-0011

Dear Denise:

Please find attached the monthly reports for compliance with the Safe Drinking Water Act and Maine's Rules Relating to Drinking Water for February, 2025.

You should find the following documents:


1. Operating report;
2. Water production report;
3. Triangle fluoridation report; and
4. Togus disinfection report.

Note that due to a PFAS 'sum of six' sample result of 23.3 parts per trillion that the Riverside station wells were removed from service on November 19, 2024.

If you have any questions, please contact me at 622-3701.

Sincerely,

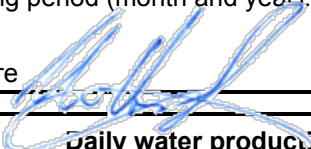
Brian Tarbuck, PE, System Class IV 2026

Monthly Operating Report		System Information	
System Type - All GW systems		Treatment plant/pump station: Triangle	
System Name:	Greater Augusta Utility District	Community water system	
PWSID#:	90080	List any new or changed system information and any operational problems or comments below.	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greataugustautilitydistrict.org			
Reporting period:	February, 2025		
Signature:			3/4/2025

Triangle Station						
Date	Gallons (MGD)	pH	Average free chlorine residual	Calc	Hypo	NaF
				gal	gal	lbs
1	1.58	7.97	1.32	5.4	20.1	
2	1.38	7.96	1.34	4.6	17.5	
3	1.43	7.96	1.35	4.6	18.3	
4	1.31	7.96	1.36	4.2	16.7	100
5	1.63	7.99	1.33	5.1	20.7	
6	1.64	7.99	1.32	5.0	20.5	
7	2.01	8.02	1.30	5.3	24.7	
8	2.10	8.03	1.26	4.8	25.8	
9	1.60	7.98	1.30	3.7	19.6	
10	1.71	8.00	1.33	4.0	20.5	
11	1.90	7.76	1.32	4.4	23.5	
12	2.04	7.55	1.34	4.7	26.4	
13	1.69	7.59	1.41	3.6	21.7	
14	1.85	7.59	1.45	3.9	23.8	
15	1.71	7.61	1.42	3.1	22.1	
16	1.58	7.61	1.48	2.5	20.7	
17	1.71	7.65	1.43	2.7	22.0	
18	1.61	7.61	1.48	2.5	20.8	
19	1.79	7.61	1.49	2.5	23.1	
20	1.83	7.64	1.29	6.2	22.2	
21	1.85	7.56	1.32	6.6	22.6	100
22	1.79	7.60	1.24	5.8	22.1	
23	1.78	7.58	1.22	6.0	22.0	
24	1.77	7.60	1.38	6.3	21.9	
25	1.82	7.62	1.43	6.4	22.3	100
26	1.72	7.61	1.35	6.0	21.4	100
27	1.83	7.57	1.37	6.6	22.6	
28	1.90	7.61	1.40	6.8	23.3	50
Summary	48.56	7.74	1.22	133	609	450
	Sum	Average	(min.)	(total)	(total)	(total)

Chemicals Used					
(fluoride reported separately)					
	Chemical Name	Purpose	Chemical Strength	Total	Units
Calc	Calciquest 75 / 25	calcium sequestration / Pb / Cu control	75% polyphosphate	133	gallons
Hypo	Sodium hypochlorite	primary and secondary disinfection	12.50%	609	gallons
NaF	Sodium fluoride	fluoridation		450	pounds

Summary of Total Coliform Bacteria Rule - please continue to submit complete results			
Number of routine samples taken:	21	Number of repeat samples taken:	0
Number of positive samples:	0	Average chlorine residual at sites:	0.88

Monthly Well Production Report		System Information	
System Type - All GW systems		Treatment plant/pump station: All wells	
System Name:	Greater Augusta Utility District	Community System	
PWSID#:	90080	List any new or changed system information (facilities, treatments, sources, operators, address, tele, etc.):	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period (month and year):		February, 2025	
Signature 		March 4, 2025	

Daily water production (MG)				
Date	Triangle Well	South Well	Brookside Well	Sum Triangle Station
1	0.82	0.00	0.76	1.58
2	0.59	0.00	0.79	1.38
3	0.64	0.00	0.79	1.43
4	0.50	0.00	0.81	1.31
5	0.83	0.01	0.78	1.63
6	0.84	0.01	0.79	1.64
7	0.77	0.56	0.68	2.01
8	0.71	0.74	0.65	2.10
9	0.22	0.64	0.73	1.60
10	0.17	0.82	0.72	1.71
11	0.35	1.15	0.40	1.90
12	0.36	1.07	0.61	2.04
13	0.06	1.17	0.46	1.69
14	0.22	1.16	0.47	1.85
15	0.29	1.02	0.39	1.71
16	0.15	0.97	0.45	1.58
17	0.19	1.17	0.35	1.71
18	0.00	1.18	0.44	1.61
19	0.19	1.14	0.45	1.79
20	0.33	1.12	0.38	1.83
21	0.01	1.14	0.70	1.85
22	0.30	1.00	0.48	1.79
23	0.24	1.13	0.41	1.78
24	0.37	0.97	0.44	1.77
25	0.29	1.13	0.39	1.82
26	0.40	0.90	0.42	1.72
27	0.00	1.14	0.69	1.83
28	0.31	1.12	0.46	1.90
Sum	10.15	22.46	15.89	48.56

Average flow: 1.73

Monthly Fluoride Report			System Information			
System Type - Fluoride Systems			Treatment plant: Triangle Station			
System Name:		Greater Augusta Utility District	Chemical Used: Sodium fluoride			
PWSID#: 90080			Notes: See notes below for specific operating conditions.			
Reporting period:		February, 2025				
Signature:		3/4/2025	Date	GAUD mg/L	Location	A&L mg/L
			2/13/2025 10:15	0.70	12 Williams Street	0.65

Fluoride					Operating comments
Date	Gallons (MGD)	Makeup water (gallons)	Daily residual (mg/L)	Calculated residual (mg/L)	
1	1.58	52	0.80	0.59	
2	1.38	45	0.75	0.58	
3	1.43	48	0.74	0.60	
4	1.31	43	0.72	0.59	
5	1.63	54	0.77	0.60	
6	1.64	55	0.77	0.60	
7	2.01	67	0.78	0.60	
8	2.10	67	0.72	0.58	
9	1.60	53	0.73	0.59	
10	1.71	56	0.71	0.59	
11	1.90	66	0.67	0.63	
12	2.04	73	0.71	0.65	
13	1.69	58	0.75	0.62	
14	1.85	64	0.75	0.62	
15	1.71	59	0.71	0.62	
16	1.58	55	0.69	0.62	
17	1.71	58	0.68	0.61	
18	1.61	55	0.69	0.61	
19	1.79	64	0.74	0.64	
20	1.83	65	0.72	0.64	
21	1.85	64	0.77	0.62	
22	1.79	65	0.86	0.65	
23	1.78	64	0.84	0.64	
24	1.77	64	0.84	0.65	
25	1.82	65	0.84	0.64	
26	1.72	62	0.86	0.65	
27	1.83	60	0.84	0.59	
28	1.90	63	0.77	0.60	
Avg	1.73	59.34	0.76	0.62	
Min	1.31	42.70	0.67	0.58	
Max	2.10	73.20	0.86	0.65	
Total	48.56	1,661.50			

Greater Augusta Utility District, PWSID 90080

Operator: Brian Tarbuck, 2026

Togus Disinfection Station, Route 17 Augusta, Maine

Reporting month: February, 2025

Reporting date: 3/4/2025

Date	Flow (gallons)	Average chlorine residual (mg/L)	Sodium hypochlorite usage (gallons)	 Operating notes
2/1/2025	54,360	2.42	1.11	
2/2/2025	47,353	2.40	1.00	
2/3/2025	60,597	2.53	1.25	
2/4/2025	61,328	2.59	1.26	
2/5/2025	61,559	2.63	1.30	
2/6/2025	68,181	2.42	1.40	
2/7/2025	67,372	2.60	1.41	
2/8/2025	54,514	2.69	1.15	
2/9/2025	54,706	2.67	1.17	
2/10/2025	115,188	2.64	2.35	
2/11/2025	68,219	2.67	1.43	
2/12/2025	61,059	2.56	1.29	
2/13/2025	67,642	2.52	1.39	
2/14/2025	60,751	2.53	1.23	
2/15/2025	47,122	2.53	0.98	
2/16/2025	54,283	2.49	1.08	
2/17/2025	47,007	2.44	0.93	
2/18/2025	60,712	2.41	1.26	
2/19/2025	60,789	2.44	1.07	
2/20/2025	68,335	2.48	1.47	
2/21/2025	74,456	2.62	1.60	
2/22/2025	87,546	2.70	1.90	
2/23/2025	55,168	2.70	1.25	
2/24/2025	60,751	2.70	1.31	
2/25/2025	61,213	2.60	1.34	
2/26/2025	54,321	2.60	1.18	
2/27/2025	101,367	2.67	2.25	
2/28/2025	60,751	2.70	1.44	
Sum	1,796,651		37.79	
Average	64,166	2.57	1.35	
Max		2.70		

Brian Tarbuck, General Manager
btarbuck@greateraugustautilitydistrict.org

Ken Knight, Board Chair
kknight@greateraugustautilitydistrict.org

Pat Paradis, Clerk
pparadis@greateraugustautilitydistrict.org

Bob Corey, Treasurer
bcorey@greateraugustautilitydistrict.org



www.greateraugustautilitydistrict.org
12 Williams Street
Augusta, ME 04330-5225
(207) 622-3701

Cecil Munson
cmunson@greateraugustautilitydistrict.org

Bradley Sawyer
bsawyer@greateraugustautilitydistrict.org

Keith Taylor, Hallowell voting member
ktaylor@greateraugustautilitydistrict.org

Keith Luke, Augusta ex-officio member
kluke@greateraugustautilitydistrict.org

Kara Tudman Walker, Hallowell ex-officio member
ktwalker@greateraugustautilitydistrict.org

April 2, 2025

Denise Douin
State of Maine, Drinking Water Program
11 State House Station
Augusta, ME 04333-0011

Dear Denise:

Please find attached the monthly reports for compliance with the Safe Drinking Water Act and Maine's Rules Relating to Drinking Water for March, 2025.

You should find the following documents:

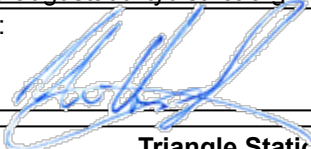
1. Operating report;
2. Water production report;
3. Triangle fluoridation report; and
4. Togus disinfection report.

Note that due to a PFAS 'sum of six' sample result of 23.3 parts per trillion that the Riverside station wells were removed from service on November 19, 2024.

If you have any questions, please contact me at 622-3701.

Sincerely,

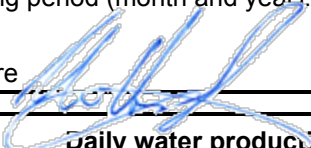
Brian Tarbuck, PE, System Class IV 2026

Monthly Operating Report		System Information	
System Type - All GW systems		Treatment plant/pump station: Triangle	
System Name:	Greater Augusta Utility District	Community water system	
PWSID#:	90080	List any new or changed system information and any operational problems or comments below.	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period:	March, 2025		
Signature:	 4/2/2025		

Triangle Station						
Date	Gallons (MGD)	pH	Average free chlorine residual	Calc	Hypo	NaF
				gal	gal	lbs
1	1.75	7.62	1.44	6.5	21.5	
2	1.76	7.61	1.42	6.4	21.8	
3	1.83	7.61	1.30	6.5	23.0	100
4	1.92	7.64	1.37	7.1	23.7	
5	1.83	7.61	1.44	6.5	22.7	
6	1.83	7.64	1.37	6.5	22.9	50
7	1.85	7.62	1.47	6.4	23.0	
8	1.73	7.62	1.48	5.8	22.0	
9	1.81	7.62	1.49	6.2	22.8	
10	1.78	7.62	1.43	6.3	21.3	100
11	1.84	7.61	1.27	6.3	22.0	
12	1.88	7.59	1.22	6.5	22.0	
13	1.74	7.61	1.24	6.2	21.0	
14	1.78	7.55	1.30	6.3	21.9	
15	1.82	7.55	1.30	6.5	22.2	
16	1.73	7.60	1.27	6.2	21.3	
17	1.74	7.57	1.30	6.2	21.2	100
18	1.81	7.60	1.30	6.3	22.4	
19	1.83	7.59	1.30	6.2	22.8	
20	1.76	7.57	1.31	6.1	21.6	
21	1.82	7.57	1.31	6.1	21.8	
22	1.69	7.62	1.27	5.9	20.3	
23	1.66	7.63	1.27	5.8	20.1	
24	1.74	7.58	1.29	6.0	21.0	100
25	1.80	7.59	1.30	6.1	21.6	
26	1.72	7.63	1.37	5.9	21.0	
27	1.83	7.61	1.30	6.2	22.1	50
28	1.82	7.60	1.33	5.8	22.0	
29	1.94	7.61	1.39	5.9	23.9	
30	1.50	7.58	1.27	4.9	15.8	
31	1.70	7.59	1.21	5.0	19.3	100
Summary	55.24	7.60	1.21	191	672	600
	Sum	Average	(min.)	(total)	(total)	(total)

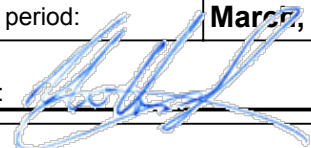
Chemicals Used					
(fluoride reported separately)					
	Chemical Name	Purpose	Chemical Strength	Total	Units
Calc	Calciquest 75 / 25	calcium sequestration / Pb / Cu control	75% polyphosphate	191	gallons
Hypo	Sodium hypochlorite	primary and secondary disinfection	12.50%	672	gallons
NaF	Sodium fluoride	fluoridation		600	pounds

Summary of Total Coliform Bacteria Rule - please continue to submit complete results			
Number of routine samples taken:	28	Number of repeat samples taken:	0
Number of positive samples:	0	Average chlorine residual at sites:	0.86

Monthly Well Production Report		System Information	
System Type - All GW systems		Treatment plant/pump station: All wells	
System Name:	Greater Augusta Utility District	Community System	
PWSID#:	90080	List any new or changed system information (facilities, treatments, sources, operators, address, tele, etc.):	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period (month and year):		March, 2025	
Signature 		April 2, 2025	

Daily water production (MG)				
Date	Triangle Well	South Well	Brookside Well	Sum Triangle Station
1	0.17	1.13	0.44	1.75
2	0.35	0.97	0.45	1.76
3	0.40	0.97	0.47	1.83
4	0.38	1.12	0.42	1.92
5	0.24	1.13	0.47	1.83
6	0.33	1.12	0.38	1.83
7	0.30	1.12	0.43	1.85
8	0.37	0.92	0.43	1.73
9	0.32	1.01	0.48	1.81
10	0.22	1.13	0.43	1.78
11	0.46	0.89	0.50	1.84
12	0.48	0.88	0.52	1.88
13	0.42	0.78	0.53	1.74
14	0.38	0.70	0.70	1.78
15	0.45	0.69	0.68	1.82
16	0.47	0.70	0.55	1.73
17	0.33	0.71	0.70	1.74
18	0.43	0.70	0.69	1.81
19	0.45	0.69	0.68	1.83
20	0.36	0.70	0.70	1.76
21	0.43	0.70	0.69	1.82
22	0.42	0.71	0.56	1.69
23	0.40	0.72	0.54	1.66
24	0.34	0.71	0.70	1.74
25	0.42	0.69	0.69	1.80
26	0.46	0.71	0.55	1.72
27	0.46	0.69	0.68	1.83
28	0.45	0.69	0.68	1.82
29	0.65	0.65	0.64	1.94
30	0.00	0.75	0.75	1.50
31	0.32	0.70	0.69	1.70
Sum	11.66	25.78	17.82	55.24

Average flow: 1.78

Monthly Fluoride Report		System Information			
System Type - Fluoride Systems		Treatment plant: Triangle Station			
System Name: Greater Augusta Utility District		Chemical used: Sodium fluoride			
PWSID#: 90080		Date	Location	GAUD mg/L	A&L mg/L
Reporting period: March, 2025		3/5/2025 10:30	12 Williams Street	0.77	0.68
Signature: 		4/2/2025			

Fluoride				
Date	Gallons (MGD)	Makeup water (gallons)	Daily residual (mg/L)	Calculated residual (mg/L)
1	1.75	57	0.73	0.58
2	1.76	60	0.74	0.61
3	1.83	63	0.75	0.62
4	1.92	65	0.77	0.61
5	1.83	63	0.78	0.61
6	1.83	63	0.77	0.62
7	1.85	63	0.77	0.61
8	1.73	60	0.77	0.62
9	1.81	62	0.75	0.61
10	1.78	59	0.74	0.60
11	1.84	63	0.75	0.62
12	1.88	63	0.75	0.60
13	1.74	60	0.78	0.62
14	1.78	62	0.77	0.62
15	1.82	63	0.75	0.62
16	1.73	59	0.75	0.61
17	1.74	58	0.69	0.60
18	1.81	63	0.69	0.62
19	1.83	62	0.73	0.61
20	1.76	59	0.79	0.61
21	1.82	60	0.73	0.59
22	1.69	53	0.61	0.56
23	1.66	53	0.61	0.57
24	1.74	56	0.71	0.58
25	1.80	61	0.74	0.61
26	1.72	58	0.80	0.61
27	1.83	62	0.75	0.60
28	1.82	66	0.73	0.65
29	1.94	76	0.76	0.70
30	1.50	55	0.77	0.66
31	1.70	66	0.80	0.70
Avg	1.78	60.91	0.74	0.62
Min	1.50	52.50	0.61	0.56
Max	1.94	75.60	0.80	0.70
Total	55.24	1,888.20		

Operating comments

Greater Augusta Utility District, PWSID 90080

Operator: Brian Tarbuck, 2026

Togus Disinfection Station, Route 17 Augusta, Maine

Reporting month:

March, 2025

Reporting date: 4/2/2025

Date	Flow (gallons)	Average chlorine residual (mg/L)	Sodium hypochlorite usage (gallons)	Operating notes
3/1/2025	54,206	2.71	1.29	
3/2/2025	47,238	2.73	1.13	
3/3/2025	60,520	2.84	1.45	
3/4/2025	68,027	2.75	1.78	
3/5/2025	101,405	2.64	2.31	
3/6/2025	60,789	2.68	1.42	
3/7/2025	68,296	2.71	1.56	
3/8/2025	54,013	2.60	1.18	
3/9/2025	56,442	2.56	1.26	
3/10/2025	67,796	2.53	1.54	
3/11/2025	68,065	2.65	1.54	
3/12/2025	94,167	2.69	2.09	
3/13/2025	60,635	2.75	1.37	
3/14/2025	74,803	2.69	1.67	
3/15/2025	53,936	2.68	1.17	
3/16/2025	47,199	2.77	1.06	
3/17/2025	108,835	2.66	2.47	
3/18/2025	69,721	2.51	1.63	
3/19/2025	101,328	2.54	2.24	
3/20/2025	73,956	2.79	1.64	
3/21/2025	67,295	2.82	1.48	
3/22/2025	53,898	2.86	1.16	
3/23/2025	54,129	2.86	1.16	
3/24/2025	76,843	2.47	1.18	
3/25/2025	67,642	2.50	0.94	
3/26/2025	109,413	2.68	1.52	
3/27/2025	74,302	2.54	0.92	
3/28/2025	60,866	2.56	0.85	
3/29/2025	47,276	2.56	0.67	
3/30/2025	54,090	2.54	0.80	
3/31/2025	107,796	2.41	1.48	
Sum	2,164,931		43.96	
Average	69,836	2.65	1.42	
Max		2.86		

Brian Tarbuck, General Manager
btarbuck@greateraugustautilitydistrict.org

Ken Knight, Board Chair
kknight@greateraugustautilitydistrict.org

Pat Paradis, Clerk
pparadis@greateraugustautilitydistrict.org

Bob Corey, Treasurer
bcorey@greateraugustautilitydistrict.org



www.greateraugustautilitydistrict.org
12 Williams Street
Augusta, ME 04330-5225
(207) 622-3701

Cecil Munson
cmunson@greateraugustautilitydistrict.org

Bradley Sawyer
bsawyer@greateraugustautilitydistrict.org

Keith Taylor, Hallowell voting member
ktaylor@greateraugustautilitydistrict.org

Keith Luke, Augusta ex-officio member
kluke@greateraugustautilitydistrict.org

Kara Tudman Walker, Hallowell ex-officio member
ktwalker@greateraugustautilitydistrict.org

May 6, 2025

Denise Douin
State of Maine, Drinking Water Program
11 State House Station
Augusta, ME 04333-0011

Dear Denise:

Please find attached the monthly reports for compliance with the Safe Drinking Water Act and Maine's Rules Relating to Drinking Water for April, 2025.

You should find the following documents:


1. Operating report;
2. Water production report;
3. Triangle fluoridation report; and
4. Togus disinfection report.

Note that due to a PFAS 'sum of six' sample result of 23.3 parts per trillion that the Riverside station wells were removed from service on November 19, 2024.

If you have any questions, please contact me at 622-3701.

Sincerely,

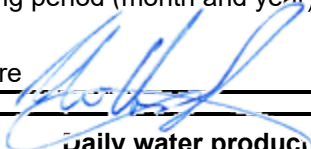
Brian Tarbuck, PE, System Class IV 2026

Monthly Operating Report		System Information	
System Type - All GW systems		Treatment plant/pump station: Triangle	
System Name:	Greater Augusta Utility District	Community water system	
PWSID#:	90080	List any new or changed system information and any operational problems or comments below.	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period:	April, 2025		
Signature:	 5/6/2025		

Triangle Station						
Date	Gallons (MGD)	pH	Average free chlorine residual	Calc	Hypo	NaF
				gal	gal	lbs
1	1.65	7.66	1.06	4.1	18.2	
2	1.83	7.61	1.16	4.4	20.7	
3	1.72	7.61	1.16	4.3	19.9	
4	1.77	7.62	1.27	4.5	20.9	50
5	1.71	7.63	1.27	4.4	20.2	
6	1.63	7.63	1.24	4.3	19.2	100
7	1.82	7.64	1.20	4.8	21.4	
8	1.63	7.62	1.18	4.3	19.1	
9	1.83	7.62	1.24	4.8	22.1	
10	1.83	7.62	1.19	4.8	25.9	
11	1.80	7.63	1.12	4.8	29.3	100
12	1.57	7.63	1.11	4.2	24.8	
13	1.76	7.63	1.08	4.6	28.8	
14	1.70	7.67	1.22	4.5	27.9	
15	1.70	7.64	1.25	4.5	24.0	
16	1.83	7.65	1.23	4.7	25.3	
17	1.79	7.65	1.25	4.6	25.2	
18	1.81	7.65	1.29	4.6	24.9	100
19	1.59	7.69	1.23	4.0	21.3	
20	1.62	7.64	1.28	4.1	21.9	
21	1.76	7.64	1.25	4.5	23.9	
22	1.72	7.67	1.25	4.4	23.4	50
23	1.73	7.69	1.35	4.4	23.6	
24	1.80	7.66	1.30	4.5	22.4	
25	1.68	7.65	1.28	4.3	21.1	
26	1.74	7.65	1.28	4.3	21.7	
27	1.56	7.65	1.25	4.0	19.1	
28	1.84	7.66	1.25	4.7	23.3	100
29	1.83	7.68	1.24	4.7	23.3	
30	1.85	7.68	1.25	4.7	23.5	
Summary	52.10	7.65	1.06	134	686	500
	Sum	Average	(min.)	(total)	(total)	(total)


Chemicals Used					
(fluoride reported separately)					
	Chemical Name	Purpose	Chemical Strength	Total	Units
Calc	Calciquest 75 / 25	calcium sequestration / Pb / Cu control	75% polyphosphate	134	gallons
Hypo	Sodium hypochlorite	primary and secondary disinfection	12.50%	686	gallons
NaF	Sodium fluoride	fluoridation		500	pounds

Summary of Total Coliform Bacteria Rule - please continue to submit complete results			
Number of routine samples taken:	28	Number of repeat samples taken:	0
Number of positive samples:	0	Average chlorine residual at sites:	0.87

Monthly Well Production Report		System Information		
System Type - All GW systems		Treatment plant/pump station: All wells		
System Name:	Greater Augusta Utility District	Community System		
PWSID#:	90080	List any new or changed system information (facilities, treatments, sources, operators, address, tele, etc.):		
Designated operator name and ME License #:	Brian Tarbuck			
	2026			
bstarbuck@greataugustautilitydistrict.org				
Reporting period (month and year):				April, 2025
Signature 				May 6, 2025

Daily water production (MG)				
Date	Triangle Well	South Well	Brookside Well	Sum Triangle Station
1	0.47	0.69	0.49	1.65
2	0.43	0.70	0.69	1.83
3	0.30	0.71	0.70	1.72
4	0.38	0.70	0.69	1.77
5	0.31	0.70	0.70	1.71
6	0.20	0.72	0.71	1.63
7	0.45	0.69	0.68	1.82
8	0.19	0.73	0.72	1.63
9	0.47	0.68	0.67	1.83
10	0.47	0.68	0.67	1.83
11	0.43	0.69	0.68	1.80
12	0.10	0.74	0.73	1.57
13	0.38	0.69	0.68	1.76
14	0.45	0.70	0.54	1.70
15	0.28	0.71	0.70	1.70
16	0.49	0.68	0.67	1.83
17	0.41	0.70	0.68	1.79
18	0.44	0.69	0.67	1.81
19	0.32	0.74	0.53	1.59
20	0.19	0.72	0.71	1.62
21	0.36	0.71	0.69	1.76
22	0.31	0.71	0.69	1.72
23	0.47	0.72	0.54	1.73
24	0.43	0.70	0.68	1.80
25	0.27	0.71	0.69	1.68
26	0.30	0.73	0.71	1.74
27	0.09	0.75	0.72	1.56
28	0.46	0.70	0.68	1.84
29	0.47	0.69	0.67	1.83
30	0.46	0.70	0.69	1.85
Sum	10.78	21.18	20.07	52.10

Average flow: 1.74

Monthly Fluoride Report		System Information			
System Type - Fluoride Systems		Treatment plant: Triangle Station			
System Name: Greater Augusta Utility District		Chemical used: Sodium fluoride			
		Date	Location	GAUD mg/L	A&L mg/L
PWSID#: 90080		4/8/2025 11:00	12 Williams Street	0.72	0.64
Reporting period: April 2025					
Signature: 		5/6/2025			

Operating comments

Fluoride				
Date	Gallons (MGD)	Makeup water (gallons)	Daily residual (mg/L)	Calculated residual (mg/L)
1	1.65	65	0.85	0.71
2	1.83	73	0.78	0.71
3	1.72	68	0.75	0.71
4	1.77	70	0.74	0.71
5	1.71	66	0.71	0.69
6	1.63	59	0.67	0.65
7	1.82	56	0.61	0.56
8	1.63	39	0.56	0.43
9	1.83	49	0.73	0.48
10	1.83	49	0.73	0.48
11	1.80	48	0.72	0.48
12	1.57	41	0.63	0.47
13	1.76	47	0.66	0.48
14	1.70	47	0.66	0.49
15	1.70	49	0.67	0.52
16	1.83	54	0.68	0.53
17	1.79	52	0.76	0.52
18	1.81	55	0.71	0.54
19	1.59	52	0.64	0.58
20	1.62	54	0.64	0.60
21	1.76	61	0.61	0.62
22	1.72	63	0.67	0.66
23	1.73	66	0.74	0.69
24	1.80	69	0.74	0.69
25	1.68	65	0.71	0.69
26	1.74	68	0.68	0.70
27	1.56	60	0.64	0.69
28	1.84	74	0.69	0.72
29	1.83	73	0.78	0.72
30	1.85	74	0.79	0.72
Avg	1.74	58.78	0.70	0.61
Min	1.56	38.60	0.56	0.43
Max	1.85	74.10	0.85	0.72
Total	52.10	1,763.30		

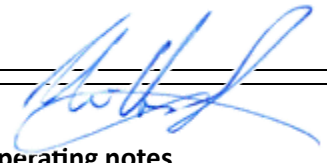
Greater Augusta Utility District, PWSID 90080

Operator: Brian Tarbuck, 2026

Togus Disinfection Station, Route 17 Augusta, Maine

Reporting month: April, 2025

Reporting date: 5/6/2025



Date	Flow (gallons)	Average chlorine residual (mg/L)	Sodium hypochlorite usage (gallons)	Operating notes
4/1/2025	67,834	1.96	1.00	
4/2/2025	67,680	2.26	0.94	
4/3/2025	105,756	2.16	1.52	
4/4/2025	62,522	2.35	0.88	
4/5/2025	54,860	2.41	0.87	
4/6/2025	54,206	2.30	0.76	
4/7/2025	94,822	2.32	1.36	
4/8/2025	116,497	2.38	1.45	
4/9/2025	94,437	2.38	1.42	
4/10/2025	67,796	2.47	1.02	
4/11/2025	114,880	2.64	1.67	
4/12/2025	54,899	2.64	0.65	
4/13/2025	54,437	2.61	0.94	
4/14/2025	53,628	2.53	0.67	
4/15/2025	109,913	2.38	1.43	
4/16/2025	60,751	2.28	0.78	
4/17/2025	121,578	2.30	1.75	
4/18/2025	75,226	2.52	1.17	
4/19/2025	53,705	2.51	0.86	
4/20/2025	47,353	2.48	0.72	
4/21/2025	105,178	2.53	1.74	
4/22/2025	60,866	2.48	0.86	
4/23/2025	67,834	2.40	0.97	
4/24/2025	61,136	2.54	0.96	
4/25/2025	60,751	2.30	0.92	
4/26/2025	48,470	2.10	0.75	
4/27/2025	17,671	2.39	0.29	
4/28/2025	108,489	2.60	1.51	
4/29/2025	67,834	2.60	0.88	
4/30/2025	74,187	2.33	1.03	
Sum	2,205,197		31.77	
Average	73,507	2.41	1.06	
Max		2.64		

Brian Tarbuck, General Manager
btarbuck@greateraugustautilitydistrict.org

Ken Knight, Board Chair
kknight@greateraugustautilitydistrict.org

Pat Paradis, Clerk
pparadis@greateraugustautilitydistrict.org

Bob Corey, Treasurer
bcorey@greateraugustautilitydistrict.org



www.greateraugustautilitydistrict.org
12 Williams Street
Augusta, ME 04330-5225
(207) 622-3701

Cecil Munson
cmunson@greateraugustautilitydistrict.org

Bradley Sawyer
bsawyer@greateraugustautilitydistrict.org

Keith Taylor, Hallowell voting member
ktaylor@greateraugustautilitydistrict.org

Keith Luke, Augusta ex-officio member
kluke@greateraugustautilitydistrict.org

Kara Tudman Walker, Hallowell ex-officio member
ktwalker@greateraugustautilitydistrict.org

June 9, 2025

Denise Douin
State of Maine, Drinking Water Program
11 State House Station
Augusta, ME 04333-0011

Dear Denise:

Please find attached the monthly reports for compliance with the Safe Drinking Water Act and Maine's Rules Relating to Drinking Water for May, 2025.

You should find the following documents:

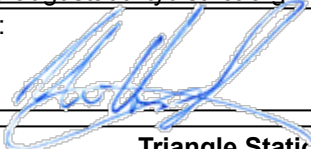
1. Operating report;
2. Water production report;
3. Triangle fluoridation report; and
4. Togus disinfection report.

Note that due to a PFAS 'sum of six' sample result of 23.3 parts per trillion that the Riverside station wells were removed from service on November 19, 2024.

If you have any questions, please contact me at 622-3701.

Sincerely,

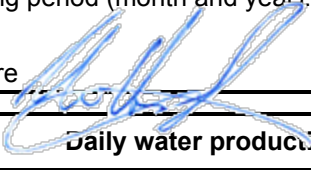
Brian Tarbuck, PE, System Class IV 2026

Monthly Operating Report		System Information	
System Type - All GW systems		Treatment plant/pump station: Triangle	
System Name:	Greater Augusta Utility District	Community water system	
PWSID#:	90080	List any new or changed system information and any operational problems or comments below.	
Designated operator name and ME License #:	Brian Tarbuck 2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period:	May, 2025		
Signature:	 6/9/2025		

Triangle Station						
Date	Gallons (MGD)	pH	Average free chlorine residual	Calc	Hypo	NaF
				gal	gal	lbs
1	1.86	7.63	1.24	4.7	23.6	150
2	1.73	7.64	1.23	4.4	21.7	
3	1.79	7.66	1.22	4.5	22.7	
4	1.46	7.69	1.19	3.8	18.4	
5	1.87	7.66	1.20	4.7	23.6	
6	1.90	7.66	1.19	4.8	24.2	
7	1.87	7.67	1.21	4.7	23.9	100
8	1.94	7.68	1.22	4.8	25.3	
9	1.93	7.68	1.24	4.8	25.5	
10	1.71	7.69	1.18	4.3	22.0	
11	1.98	7.68	1.22	4.9	25.8	
12	2.08	7.68	1.23	5.1	25.8	100
13	2.09	7.76	1.26	5.2	25.7	
14	2.24	7.66	1.19	5.9	27.7	
15	2.05	7.63	1.24	5.7	25.0	
16	2.13	7.71	1.25	6.0	26.2	
17	2.12	7.74	1.24	6.0	26.0	
18	1.96	7.68	1.21	5.5	23.5	
19	1.97	7.63	1.23	5.6	23.9	100
20	2.13	7.63	1.32	6.0	26.3	
21	2.13	7.67	1.32	6.0	25.9	
22	2.08	7.68	1.33	5.9	25.5	
23	2.08	7.65	1.31	5.9	25.4	
24	1.92	7.68	1.30	5.5	23.1	
25	1.91	7.70	1.28	5.5	22.7	
26	1.92	7.67	1.26	5.5	22.8	
27	2.14	7.75	1.27	6.1	25.9	
28	2.10	7.70	1.26	6.0	25.5	
29	2.23	7.70	1.26	6.4	27.2	
30	2.24	7.68	1.29	6.5	28.2	50
31	2.03	7.71	1.25	6.0	25.3	
Summary	61.59	7.68	1.18	167	764	500
	Sum	Average	(min.)	(total)	(total)	(total)

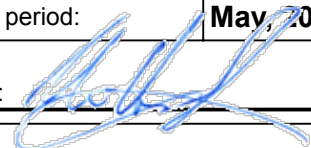
Chemicals Used					
(fluoride reported separately)					
	Chemical Name	Purpose	Chemical Strength	Total	Units
Calc	Calciquest 75 / 25	calcium sequestration / Pb / Cu control	75% polyphosphate	167	gallons
Hypo	Sodium hypochlorite	primary and secondary disinfection	12.50%	764	gallons
NaF	Sodium fluoride	fluoridation		500	pounds

Summary of Total Coliform Bacteria Rule - please continue to submit complete results			
Number of routine samples taken:	27	Number of repeat samples taken:	0
Number of positive samples:	0	Average chlorine residual at sites:	0.79

Monthly Well Production Report		System Information	
System Type - All GW systems		Treatment plant/pump station: All wells	
System Name:	Greater Augusta Utility District	Community System	
PWSID#:	90080	List any new or changed system information (facilities, treatments, sources, operators, address, tele, etc.):	
Designated operator name and ME License #:	Brian Tarbuck		
	2026		
btarbuck@greteraugustautilitydistrict.org			
Reporting period (month and year):		May, 2025	
Signature 		June 9, 2025	

Daily water production (MG)				
Date	Triangle Well	South Well	Brookside Well	Sum Triangle Station
1	0.48	0.70	0.68	1.86
2	0.28	0.74	0.71	1.73
3	0.39	0.71	0.68	1.79
4	0.14	0.78	0.55	1.46
5	0.48	0.70	0.68	1.87
6	0.52	0.71	0.67	1.90
7	0.42	0.74	0.71	1.87
8	0.44	0.76	0.73	1.94
9	0.47	0.75	0.72	1.93
10	0.36	0.79	0.57	1.71
11	0.49	0.77	0.72	1.98
12	0.61	0.75	0.71	2.08
13	0.64	0.75	0.70	2.09
14	0.83	0.73	0.68	2.24
15	0.59	0.75	0.71	2.05
16	0.68	0.75	0.70	2.13
17	0.69	0.74	0.69	2.12
18	0.46	0.77	0.73	1.96
19	0.47	0.77	0.73	1.97
20	0.69	0.74	0.70	2.13
21	0.69	0.74	0.70	2.13
22	0.63	0.74	0.70	2.08
23	0.65	0.74	0.70	2.08
24	0.43	0.76	0.73	1.92
25	0.42	0.76	0.72	1.91
26	0.43	0.76	0.73	1.92
27	0.72	0.73	0.68	2.14
28	0.65	0.75	0.70	2.10
29	0.83	0.73	0.67	2.23
30	0.83	0.74	0.67	2.24
31	0.64	0.72	0.67	2.03
Sum	17.05	23.07	21.44	61.59

Average flow: 1.99

Monthly Fluoride Report		System Information			
System Type - Fluoride Systems		Treatment plant: Triangle Station			
System Name: Greater Augusta Utility District		Chemical used: Sodium fluoride			
PWSID#: 90080		Date	Location	GAUD mg/L	A&L mg/L
Reporting period: May, 2025		5/7/2025 13:15	12 Williams Street	0.75	0.71
Signature: 		6/9/2025			

Fluoride				
Date	Gallons (MGD)	Makeup water (gallons)	Daily residual (mg/L)	Calculated residual (mg/L)
1	1.86	62	0.69	0.60
2	1.73	64	0.68	0.67
3	1.79	72	0.69	0.72
4	1.46	58	0.70	0.71
5	1.87	75	0.80	0.72
6	1.90	75	0.86	0.71
7	1.87	72	0.86	0.69
8	1.94	75	0.86	0.69
9	1.93	75	0.85	0.70
10	1.71	66	0.87	0.69
11	1.98	76	0.85	0.69
12	2.08	81	0.84	0.70
13	2.09	82	0.78	0.70
14	2.24	88	0.74	0.71
15	2.05	80	0.79	0.70
16	2.13	83	0.75	0.70
17	2.12	82	0.71	0.70
18	1.96	75	0.65	0.69
19	1.97	78	0.67	0.71
20	2.13	86	0.84	0.72
21	2.13	86	0.87	0.73
22	2.08	81	0.84	0.70
23	2.08	81	0.81	0.70
24	1.92	74	0.83	0.69
25	1.91	73	0.81	0.69
26	1.92	74	0.74	0.70
27	2.14	84	0.72	0.71
28	2.10	82	0.81	0.71
29	2.23	88	0.85	0.71
30	2.24	87	0.85	0.70
31	2.03	78	0.82	0.69
Avg	1.99	77.16	0.79	0.70
Min	1.46	57.90	0.65	0.60
Max	2.24	88.30	0.87	0.73
Total	61.59	2,392.10		

Operating comments

Greater Augusta Utility District, PWSID 90080

Operator: Brian Tarbuck, 2026

Togus Disinfection Station, Route 17 Augusta, Maine

Reporting month: May, 2025

Reporting date: 6/9/2025

Date	Flow (gallons)	Average chlorine residual (mg/L)	Sodium hypochlorite usage (gallons)	Operating notes
5/1/2025	91,935	2.43	1.43	
5/2/2025	67,334	2.19	1.01	
5/3/2025	55,130	2.06	0.83	
5/4/2025	65,294	2.32	0.98	
5/5/2025	149,567	2.65	2.29	
5/6/2025	63,215	2.56	1.02	
5/7/2025	112,223	2.26	1.93	
5/8/2025	60,789	2.37	0.98	
5/9/2025	71,415	2.46	1.21	
5/10/2025	54,899	2.46	0.92	
5/11/2025	54,013	2.42	0.80	
5/12/2025	67,834	2.47	1.00	
5/13/2025	71,145	2.43	1.07	
5/14/2025	73,070	2.44	1.10	
5/15/2025	78,229	2.46	1.41	
5/16/2025	82,040	2.52	1.33	
5/17/2025	33,609	2.45	0.53	
5/18/2025	60,828	2.38	0.96	
5/19/2025	81,155	2.48	1.27	
5/20/2025	68,566	2.32	1.20	
5/21/2025	82,040	2.50	1.28	
5/22/2025	81,694	2.62	1.15	
5/23/2025	40,462	2.52	0.56	
5/24/2025	33,879	2.34	0.46	
5/25/2025	68,450	2.30	1.00	
5/26/2025	34,533	2.23	0.48	
5/27/2025	67,719	2.39	1.04	
5/28/2025	94,591	2.42	1.51	
5/29/2025	75,650	2.41	1.27	
5/30/2025	87,931	2.36	1.81	
5/31/2025	27,103	2.32	0.43	
Sum	2,156,343		34.27	
Average	69,559	2.40	1.11	
Max		2.65		